

Installation Instructions / Notice de montage



WARNING
ELECTRICAL SHOCK HAZARD

AVERTISSEMENT
RISQUE D'ÉLECTROCUTION

READ and UNDERSTAND these instructions before installing luminaire.

LISEZ cette notice et assurez-vous de la **COMPRENDRE** avant de monter le luminaire.

EN

Disconnect the Electrical supply power at the services panel (fuse or circuit breaker box). Failure to do so could result in serious injury. Only qualified electricians should install this luminaire and the installation MUST conform to the Canadian Electrical Code Part I and any local codes and ordinances. Make sure you have the proper tools and materials to complete the installation before attempting to install the luminaire. For CANADA ONLY installations on 208, 240, 480 or 600 volt line-to-line supply voltages require the use of ISOLATED SECONDARY type ballasts ONLY. Auto-transformer type ballasts must not be used. If replacement of the ballast is required, install the same type ballast as was originally installed. Failure to do so could result in serious injury from shock. This luminaire, when equipped with a quad volt autotransformer ballast (120/208/240/277), must not be installed on line to line electrical distribution systems.

INSTALLATION

1. Disconnect all power to the wiring intended to be connected to the luminaire.
2. Attach the reflector to the socket plate (Fig. 1).
* For D type connect the "Quick Connect" before attaching the reflector.
3. Assemble the lens/ring assembly to the reflector (Fig. 2). Attach lens or lens/ring assembly to the fixture housing using the safety cable or safety chain (provided) Fig 3.
4. Insert the lamp into the socket and tighten firmly.
5. Mount the luminaire to a suitable and secure hanging device. Check that the location of the fixture agrees with the layout design.
6. Make connections to the power supply, observing polarity and luminaire's nameplate rating. Apply power.


FR

Couper l'alimentation du courant électrique au panneau de service (boîte de fusibles ou disjoncteurs), sans quoi il pourrait en résulter des blessures sérieuses. Seuls des électriciens qualifiés devraient installer ce luminaire et l'installation DOIT être conforme au Code canadien de l'électricité, Première partie, ainsi qu'aux codes et règlements locaux. Assurez-vous d'avoir les outils et le matériel nécessaires à l'installation avant d'essayer d'installer le luminaire. Pour CANADA seulement - les installations sur 208, 240, 480 ou 600 V sur des tensions phase à phase nécessitent l'utilisation de ballasts avec SECONDAIRE ISOLÉ seulement. Dans ces cas, ne pas utiliser de ballasts de type autotransformateur. Si le remplacement du ballast est nécessaire, installer le même type de ballast que celui installé par Stanpro, sans quoi il pourrait en résulter des blessures sérieuses par électrocution. Ce luminaire, lorsque muni d'un ballast autotransformateur à quatre tensions (120/208/240/277), ne doit pas être installé sur les systèmes de distribution électrique phase à phase.

MONTAGE

1. Couper l'alimentation du circuit où le luminaire sera raccordé.
2. Attacher le réflecteur à la plaque de douille (Fig. 1).
* Pour le type D, raccorder le connecteur à verrouillage rapide avant assembler le réflecteur.
3. Joindre l'ensemble lentille/anneau au réflecteur (Fig. 2). Attacher la lentille ou l'ensemble lentille/anneau au boîtier du ballast au moyen du câble ou de la chaîne de sécurité fourni (Fig 3).
4. Insérer la lampe dans la douille et la serrer fermement.
5. Accrocher le luminaire à un dispositif de suspension adéquat et sécuritaire. S'assurer que l'emplacement du luminaire convient bien à l'aménagement de la pièce.
6. En respectant les polarités et la plaque signalétique, effectuer les branchements au panneau de distribution. Mettre sous tension.

Fig. 1 Reflector mounting / Montage du réflecteur

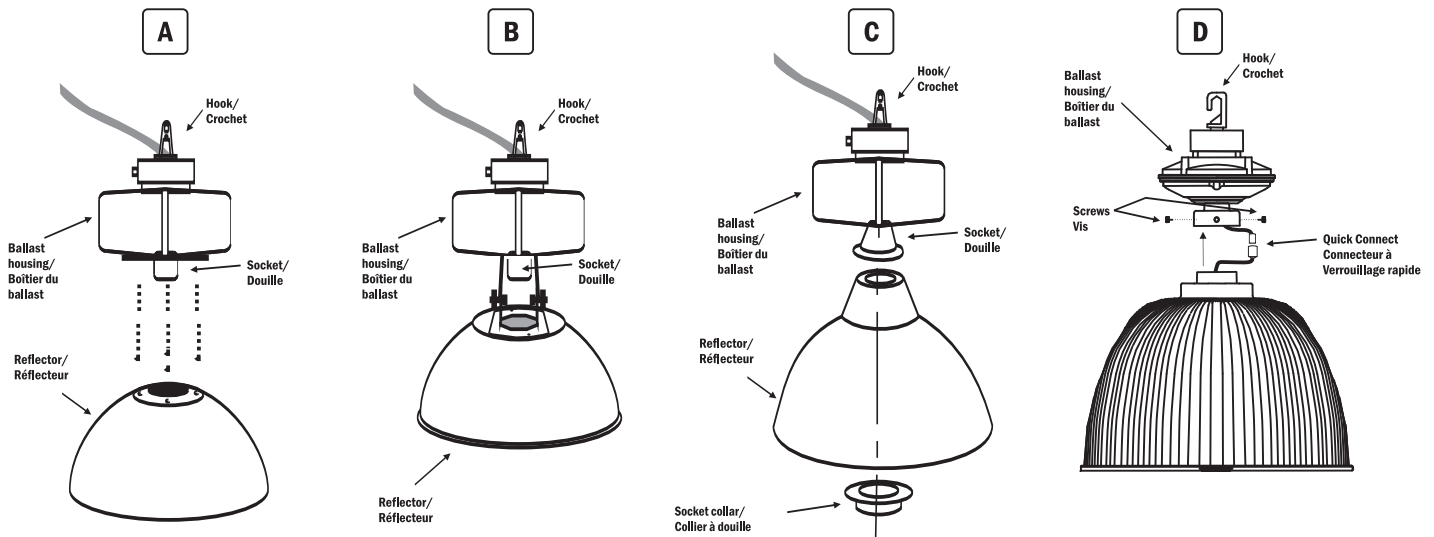

NOTE: LUMINAIRE'S STYLE AND BALLAST TYPE WILL VARY WITH LUMINAIRE OPTIONS.

NOTE: LA CONFIGURATION DU LUMINAIRE ET LE TYPE DE BALLAST DEPENDENT DES OPTIONS DU LUMINAIRE

Fig. 2 Lens mounting / Montage de la lentille

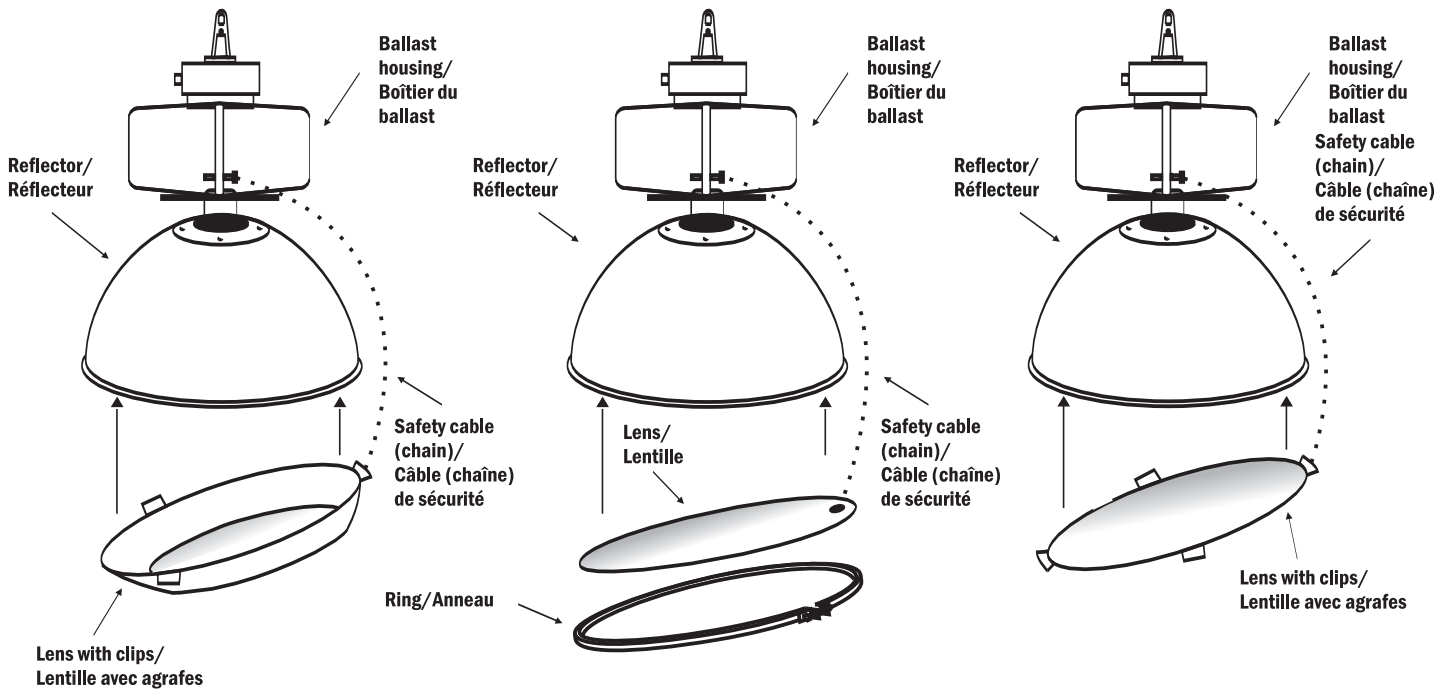


Fig. 3 Safety chain attachment / Fixation de la chaîne de sécurité


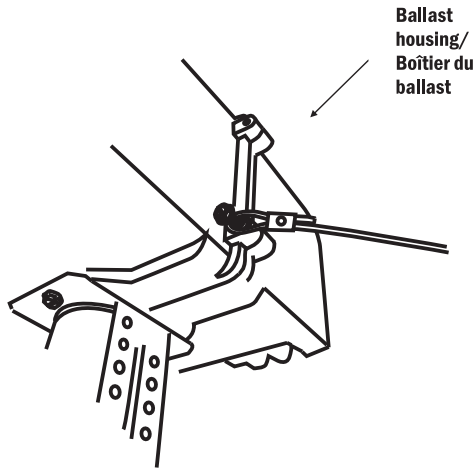


Fig. 4 Low profile mounting / Montage à profil bas

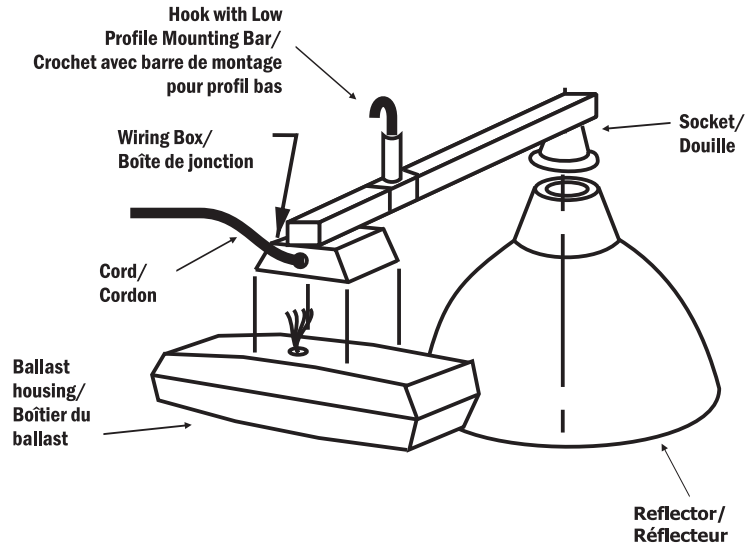

EN RELAMP

1. Before lamp replacement, shut power off and allow lamp and fixture to cool to avoid electrical shock and potential burn hazards.
2. Any HID lamp should be replaced as soon as possible after failure. Failure to promptly replace cycling lamps may damage the fixture or components. For High Pressure Sodium and Pulse Start Metal Halide lamps, lamps **MUST** be replaced promptly. These lamps will begin to cycle (turn on and off repeatedly) near end of life. Failure to replace these lamps can lead to premature ballast and components failure, and potential non-passive failure of the lamp.
3. Check that the **LAMP WATTAGE** and **TYPE** agree with the luminaire's nameplate rating. Detach the lens/ring assembly; remove the old lamp; insert the new lamp and tighten firmly into the socket. Re-attach the lens/ring assembly.

FR REMPLACEMENT DE LA LAMPE

1. Avant de remplacer la lampe, couper le courant et laisser la lampe et le luminaire se refroidir pour éviter tout risque d'électrocution ou de brûlure.
2. Toute lampe DHI devrait être remplacée aussitôt que possible après être tombée en panne. Faute de remplacer promptement les lampes en cyclage, le luminaire ou ses composants peuvent s'endommager. Pour les lampes au sodium à haute pression et aux halogénures métalliques à démarrage assisté, les lampes **DOIVENT** être remplacées promptement. Ces lampes commencent à cycliser (s'allumer et s'éteindre de façon répétitive) vers la fin de leur vie. Le défaut de remplacer ces lampes peut entraîner une panne prématurée du ballast et des composants, et potentiellement une panne non-passive de la lampe.
3. Vérifier que le **WATTAGE** et le **TYPE** de LAMPE sont conformes aux exigences de la plaque signalétique du luminaire. Enlever l'ensemble lentille/anneau, enlever la vieille lampe; insérer la nouvelle lampe et la visser fermement dans la douille. Remonter l'ensemble lentille/anneau.